


SCHALTPLAN



KBS Gastrotechnik GmbH – Schoßbergstraße 26 – 65201 Wiesbaden

(Q)70SP/E400	(Q)90SP/E400	(D)72/10 SPE			DIS.N. CR0411820
(Q)70SPV/E400	(Q)90SPV/E400	ERP92-T-G-A	(D)72/10 TSPE	NSP74E	DATA 12-09-2003
(Q)70SPVP/E400	(Q)90SPVP/E400	ERP72-T-G-A	(D)92/10 SPE	NSP94E	
			(D)92/10 TSPE	SP7-4E	MOD. SP9-4E

DISEGNATO DA: NARDINI	MOD. -	FIRMA NARDINI	DATA 17.02.11	DESCRIZIONE MODIFICA AGGIUNTO MODELLI NP.OL.SK	RIF. 18015	FIRMA NARDINI	DATA 08.05.18	DESCRIZIONE MODIFICA AGGIUNTO (D) (Q)
APPROVATO DA:	-	NARDINI	20.04.12	AGGIUNTO MODELLI BA				
	-	GANDINI	20.12.12	AGGIUNTO MODELLI 70 BA				

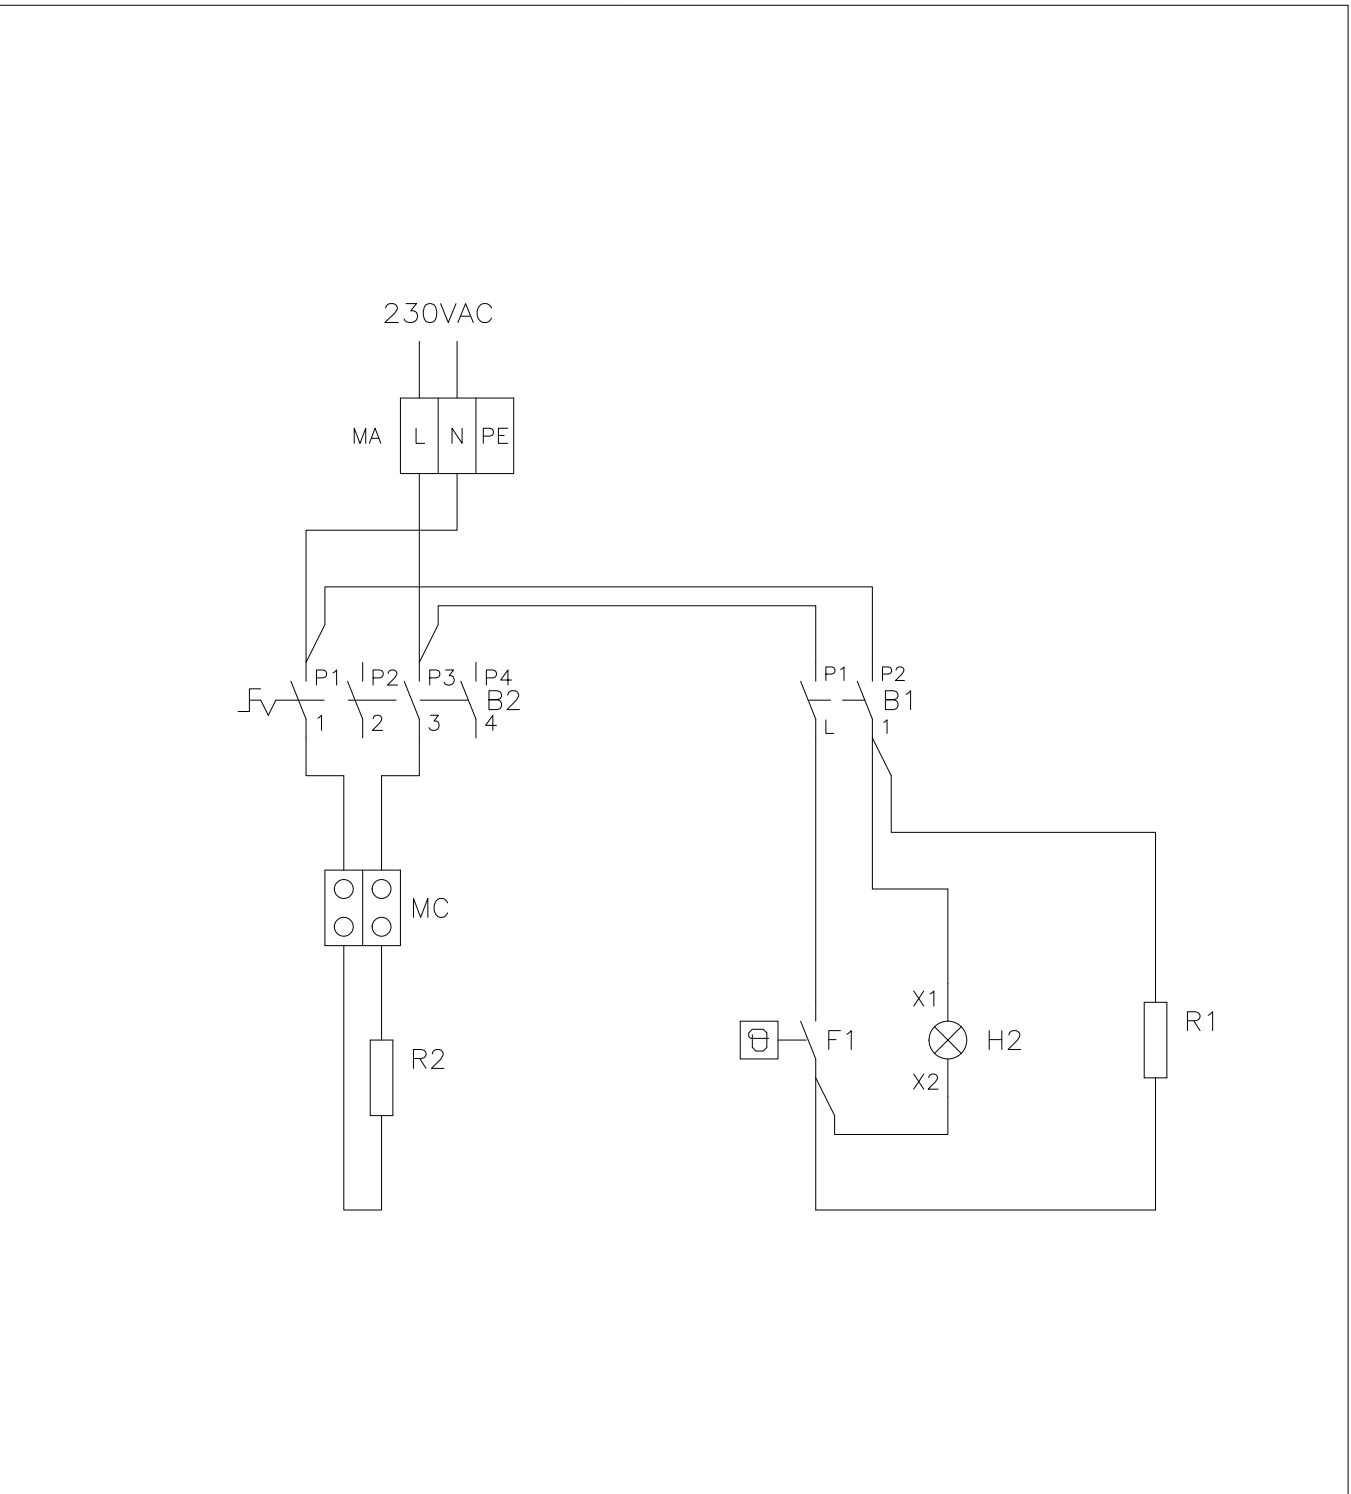

B1-B2	INTERRUTTORE	INTERRUPTEUR	CUT-OFF SWITCH	EIN-AUS SCHALTER
F1	TERMOSTATO DI LAVORO	THERMOSTAT	THERMOSTAT	THERMOSTAT
H2	SPIA ARANCIO	LAMPE ORANGE	ORANGE PILOTLIGHT	ORANGE LAMPE
MA	MORSETTIERA ARRIVO LINEA	BORNES ARRIVEE LIGNE	TERMINAL BLOCK	ANSCHLUSSKLEMME
MC	MORSETTIERA DERIVAZIONE	BLOC DE DERIVATION	TERMINAL BLOCK	REIHENKLEMME
R1-R2	RESISTENZA	RESISTANCE	HEATING ELEMENT	HEIZKORPER

POTENZA TOTALE-PUISSANCE TOTALE	230 VAC	1N	8.7 A
HEAT INPUT-ANSCHLUSSWERT	2 KW	XX VAC	XX A 50-60 Hz
	XX VAC	XX	XX A